

TALUK HEAD QUARTERS HOSPITAL

KOTHAMANGALAM ERNAKULAM DISTRICT KERALA INDIA PIN 686691

Ph. Office: 0485 2822603 Email : thqhktooffice@gmail.com

No.D-575/2026

Dated: 04.03.2026

It is certified that an inspection team headed by Ajesh P.S., Junior Health Inspector of this hospital inspected the St Stephens Bes Ania Public School , Chelad P. O, Kothamangalam on 03.03.2026 and on the basis of Water Test Report (Attached) bearing no KTML 3171/02/26 dated 23.02.2026 of Quality Control SUB DISTRICT Lab, KOTHAMANGALAM (PHED,Lab) certified that the St Stephens Bes Ania Public School, Chelad has safe drinking water facilities for the students and members of staff of the institution . School is also maintains the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central/State/U.T. Govt.

This certificate is valid till 01.03.2027



Dr. Sam Paul C
Superintendent
SUPERINTENDENT
TALUK HEAD QUARTERS HOSPITAL
KOTHAMANGALAM - 686 691

To
St. Stephens Bes Ania Public School Chelad P. O
Kothamangalam

Copy:

1. File / Stock file.

For
Bes - Ania Public School

CHAIRMAN



PRINCIPAL
St. Stephen's
Bes - Ania Public School
Chelad P.O. - 686681
Affn. No. 930354



Telephone:0485-2995332
email:-qcsdlktrml@gmail.com

KERALA WATER AUTHORITY

QUALITY CONTROL SUB DISTRICT LAB, KOTHAMANGALAM-686691
(NABL RECOGNIZED LABORATORY)

WATER TEST REPORT

Report No: KTML3171/02/26

Report Issue Date 23.02.2026

| | | |
|---|----------------------------|----------------------------|
| Customer Name & Address ST.Stephens Bes-Ania Public School Chelad | Date of Receipt of Payment | 13.02.26 |
| | Date of Sample received | 16.02.26 |
| | Sample given by | JHI THQH Kothamangalam |
| | Sample Code | 3171/02/26 |
| | Sample Name | Drinking Water |
| | Sample Condition | Good |
| | Source of Sample | Open Well |
| | Sample Quantity | 2 Litre |
| | Test performing dates : | From :17.02.26 to 21.02.26 |

| Sl.No | Characteristics | Unit | Test Method | Acceptable Limit as per IS 10500-2012 | Result |
|-------|--|--------------|---|---------------------------------------|--------|
| 1 | Turbidity | NTU | IS 3025 (Part10)-2023 | 1 | 0.5 |
| 2 | pH at 25°C | - | IS 3025 (Part 11)-1983(Reaffirmed 2022) | 6.5 to 8.5 | 6.69 |
| 3 | Total Hardness (as CaCO ₃) | mg/L | IS 3025 (Part21)-2009(Reaffirmed 2019) | 200 | 38.19 |
| 4 | Chloride (as Cl) | mg/L | IS 3025 (Part 32)-1988(Reaffirmed 2019) | 250 | 10.1 |
| 5 | Electrical conductivity at 25°C | micromhos/cm | IS 3025 (Part 14)-2013(Reaffirmed 2019) | - | 108.00 |
| 6 | Iron (as Fe) | mg/L | IS 3025 (Part 53)-2024 | 1 | 0.53 |
| 7 | Nitrate (as NO ₃) | mg/L | IS 3025 (Part 34/Sec.1) 2023 | 45 | 1.58 |

Remarks:- DL : Detectable Limit
BDL : Below Detectable Limit


NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory




Analysed By
TECHNICAL MANAGER


SAVITHA P B

| | |
|----------------------|--------------------------|
| KWA/QCSDL/KTML/F- 26 | Issue Date : 02..07.2021 |
| Rev No: 03 | Rev Date : 26.07.2024 |
| | Page 1 of 1 |


PRINCIPAL
St. Stephen's
Bes - Ania Public School
Chelad P.O. - 686681
Affn. No. 930354

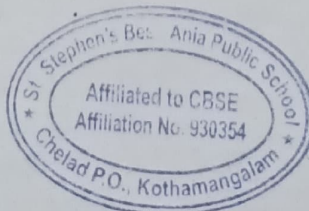

For St. Stephen's
Bes - Ania Public School


CHAIRMAN



Telephone:0485-2995332
email:-qcsdlktml@gmail.com

KERALA WATER AUTHORITY
QUALITY CONTROL SUB DISTRICT LAB, KOTHAMANGALAM-686691
WATER TEST-BACTERIOLOGY REPORT

Report No: KTML3171/02/26

Report Issue Date 23.02.2026


| | | | | |
|--|----------------|---------------------------------------|------------------------|----------------------------|
| Customer Name & Address | | Date of Receipt of Payment | 13.02.26 | |
| ST.Stephens Bes-Ania Public School Chelad | | Date of Sample received | 16.02.26 | |
| | | Sample given by | JHI THQH Kothamangalam | |
| | | Sample Code | 3171/02/26 | |
| | | Sample Name | Drinking Water | |
| | | Sample Condition | Good | |
| | | Source of Sample | Open Well | |
| | | Sample Quantity | 200 ml | |
| | | Test performing dates : | | From :16.02.26 to 17.02.26 |
| Sl. No. | Parameter | Acceptable Limit as per IS 10500-2012 | Test Method | Result |
| 1 | Total Coliform | Shall not be Detected/100ml | IS15185-2016 | Absent |
| 2 | E-Coli | Shall not be Detected/100ml | IS15185-2016 | Absent |

Remarks:-

- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory


Authorized By

SURYA S



| | | | |
|----------------------|-----------------------|-------------------------|--|
| KWA/QCSDL/KTML/F- 26 | | Issue Date : 02.07.2021 | |
| Rev No: 03 | Rev Date : 26.04.2024 | Page 1 of 1 | |

PRINCIPAL
St. Stephen's
Bes - Ania Public School
Chelad P.O. - 686681
Affn. No. 930354

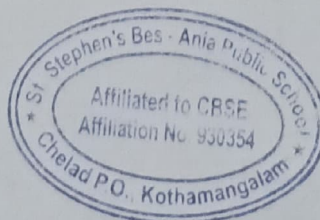

For St. Stephen's
Bes - Ania Public School

CHAIRMAN